



Pegler Yorkshire

CONNECT + CONTROL

Pegler


Thermostatic mixing valve, copper x copper

PEG402 Thermostatic mixing valve TMV3/2



Size	Pattern No.	Pack 1 Qty	Pack 2 Qty	Code	Barcode	Price (£) ex VAT test
15mm	PEG402	1	10	5A1401	5022050388124	£61.63
22mm	PEG402	1	10	5A1402	5022050388247	£71.74

PEG402 Thermostatic mixing valve TMV3/2

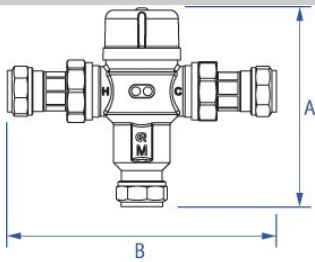

Code	Description	A	B
5A1401	15mm PEG402	94	127
5A1402	22mm PEG402	96	145

Pegler Yorkshire reserve the right to change specifications

Valves and Fittings

Pegler Yorkshire Customcare 2 Year Guarantee - Terms and Conditions

Products are subject to a 2 year guarantee that is between Pegler Yorkshire and the final purchaser of the product.

The guarantee is subject to proof of purchase being supplied.

This guarantee does not affect any statutory rights the consumer may have in law.

The guarantee covers manufacturing or material defects and does not cover parts subject to normal wear and tear.


This product range has been designed for the use of homeowners, domestic and commercial applications and therefore the guarantee is subject to the product being properly selected for their intended service conditions.

The guarantee is not applicable where the product is fitted contrary to the conditions in the fitting instructions.

Provided it is installed correctly and receives adequate preventative maintenance it should give years of trouble-free service.

Abusive behaviour and accidental damage to the product are not covered by this guarantee.

The extent of this liability is limited to the cost of the replacement of the defective item and not to fitting or consequential damages.

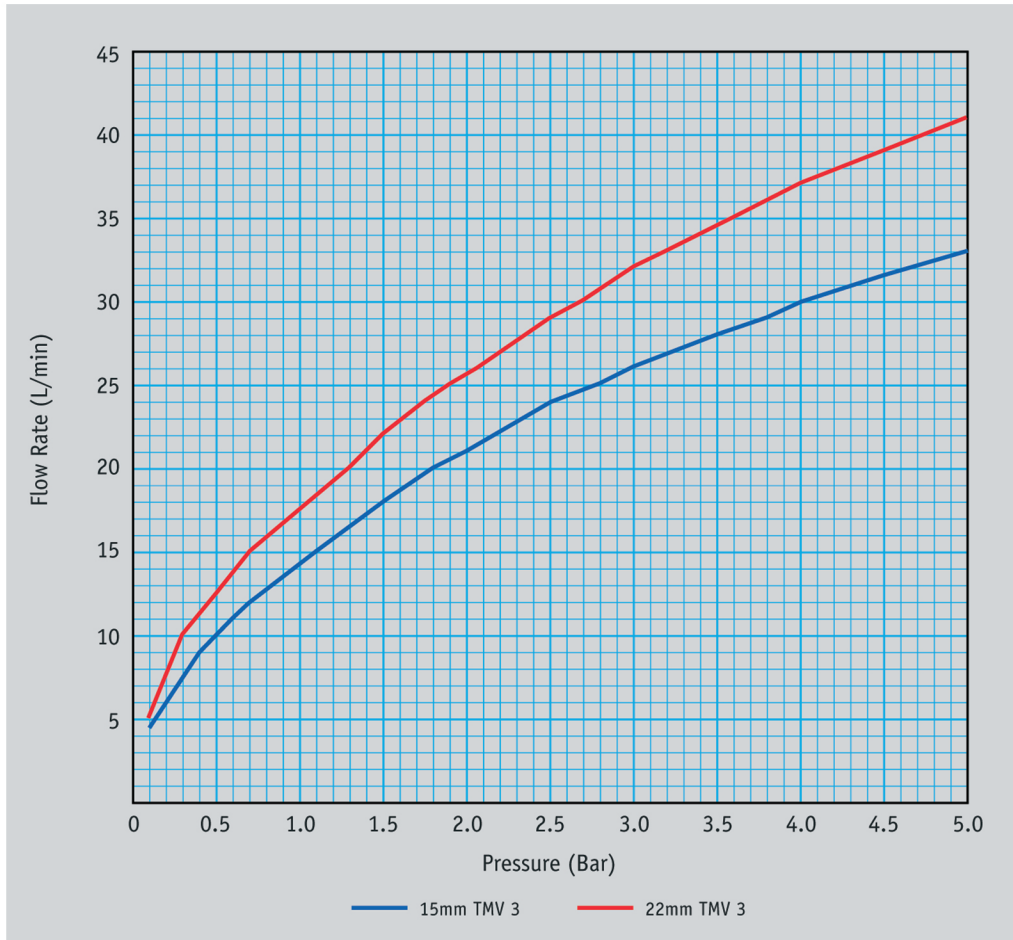

WRAS[®]

Water Regulations Advisory Scheme

This certifies that

PEGLER YORKSHIRE GROUP LTD.

has had the undermentioned product examined, tested and found, when correctly installed, to comply with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations/Scottish Water Byelaws.

**PEG402, PEG402UA, PEG402UAX, TX402, TX402UA & T402UAX
THERMOSTATIC BLENDING VALVES**


This certificate by itself is not evidence of a valid WRAS Approval. Confirmation of the current status of an approval must be obtained from the WRAS Directory (www.wras.co.uk/directory)

*The product so mentioned will be listed in the
Water Fittings and Materials Directory
for a period until:*


31 MAY 2019

1405079

Certificate No.

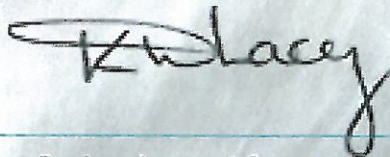

Chairman, Product Approval Group



Secretary

WRAS
**APPROVED
PRODUCT**

THIS IS TO CERTIFY THAT

Pegler Yorkshire Group

has had the following products Certified by BuildCert Limited

to the requirements of

BS EN 1111:1999 Thermostatic Mixing Valves (High Pressure)⁽¹⁾⁽²⁾
BS EN 1287:1999 Thermostatic Mixing Valves (Low Pressure)

Products covered by this certification include

PEG402 - 15mm Item code 5A1401 and **PEG402 - 22mm** Item code 5A1402
PEG402UA - 15mm Item code 5A1403 and **PEG402UA - 22mm** Item code 5A1404
PEG402UAX - 15mm Item code 5A1405 and **PEG402UAX - 22mm** Item code 5A1406
TX402 - 15mm Item Code 5A1560 and **TX402 - 22mm** Item Code 5A1561
TX402UA - 15mm Item No 5A1562 and **TX402UA - 22mm** Item No 5A1563
TX402UAX - 15mm Item No 5A1564 and **TX402UAX - 22mm** Item No 5A1565
Series 80 flowrate

Designations of use: HP-B/S/W/T (15mm)
HP-B/S/W/T & LP-B/S/W (22mm)



Signature

16th MAY 2016

Date

This approval is subject to continuing conformity with BuildCert requirements. The absence of a listing on the BuildCert website (www.buildcert.com) indicates that the approval is no longer valid

Certificate: BC1690/0316 Addition
Type Test & QMS.
Issue Date: 16th May 2016
Expiry Date: 23rd March 2021 ⁽³⁾

- (1) Excluding: Clause 14 Acoustic Characteristics
- (2) Excluding: 6.1 Marking (Acoustic & Flowrate Class)
- (3) Maximum Expiry Date - See Approval Letter



THIS IS TO CERTIFY THAT

Pegler Yorkshire Group Ltd


has had the following products Certified by BuildCert Limited
to the requirements of

**National Health Service Model Engineering Specifications D 08
Thermostatic Mixing Valves (Healthcare Premises)**

Products covered by this certification include

**PEG402, PEG402UA, PEG402UAX – 15mm and 22mm
TX402, TX402UA, TX402UAX - 15mm and 22mm**

Designations of Use: HP-B, HP-S, HP-W, HP-T44, HP-T46, LP-BE, LP-SE, LP-WE



Signature



Date

This approval is subject to continuing conformity with BuildCert requirements. The absence of a listing on the BuildCert website (www.buildcert.com) indicates that the approval is no longer valid

Certificate: BC1416/0714
Type Test & QMS
Issue Date: 28th July 2014
Expiry Date: 27th March 2019



110

THIS IS TO CERTIFY THAT

Pegler Yorkshire Group

has had the following products Certified by BuildCert Limited


to the requirements of

BS EN 1111:1999 Thermostatic Mixing Valves (High Pressure)⁽¹⁾⁽²⁾
BS EN 1287:1999 Thermostatic Mixing Valves (Low Pressure)

Products covered by this certification include

PEG402 - 15mm Item code 5A1401 and PEG402 - 22mm Item code 5A1402
PEG402UA - 15mm Item code 5A1403 and PEG402UA - 22mm Item code 5A1404
PEG402UAX - 15mm Item code 5A1405 and PEG402UAX - 22mm Item code 5A1406
TX402 - 15mm Item Code 5A1560 and TX402 - 22mm Item Code 5A1561
TX402UA - 15mm Item No 5A1562 and TX402UA - 22mm Item No 5A1563
TX402UAX - 15mm Item No 5A1564 and TX402UAX - 22mm Item No 5A1565
Series 80 flowrate

Designations of use: HP-B/S/W/T (15mm)
HP-B/S/W/T & LP-B/S/W (22mm)



Signature

16th May 2016

Date

Certificate: BC1690/0316 Addition
Type Test & QMS.

Issue Date: 16th May 2016

Expiry Date: 23rd March 2021 ⁽³⁾

This approval is subject to continuing conformity with BuildCert requirements. The absence of a listing on the BuildCert website (www.buildcert.com) indicates that the approval is no longer valid

- (1) Excluding: Clause 14 Acoustic Characteristics
- (2) Excluding: 6.1 Marking (Acoustic & Flowrate Class)
- (3) Maximum Expiry Date - See Approval Letter



110

THIS IS TO CERTIFY THAT

Pegler Yorkshire Group Ltd

has had the following products Certified by BuildCert Limited
to the requirements of

**National Health Service Model Engineering Specifications D 08
Thermostatic Mixing Valves (Healthcare Premises)**

Products covered by this certification include

Range of adjustable Tee Type Thermostatic Mixing Valves

PEG402, PEG402UA, PEG402UAX and TX402 TX402UA TX402UAX
15mm and 22 inlets/outlets

Designations of Use: HP-B, HP-S, HP-W, HP-T44, HP-T46, LP-BE, LP-SE, LP-WE
(Tub fill for 22mm only)



Signature

7th October 2016

Date

This approval is subject to continuing conformity with BuildCert requirements. The absence of a listing on the BuildCert website (www.buildcert.com) indicates that the approval is no longer valid

Certificate: BC1722/0816
Type Test & QMS
Issue Date: 7th October 2016
Expiry Date: 11th August 2021

